




8 7 6 5 4 3 2 1

D

C

B

A

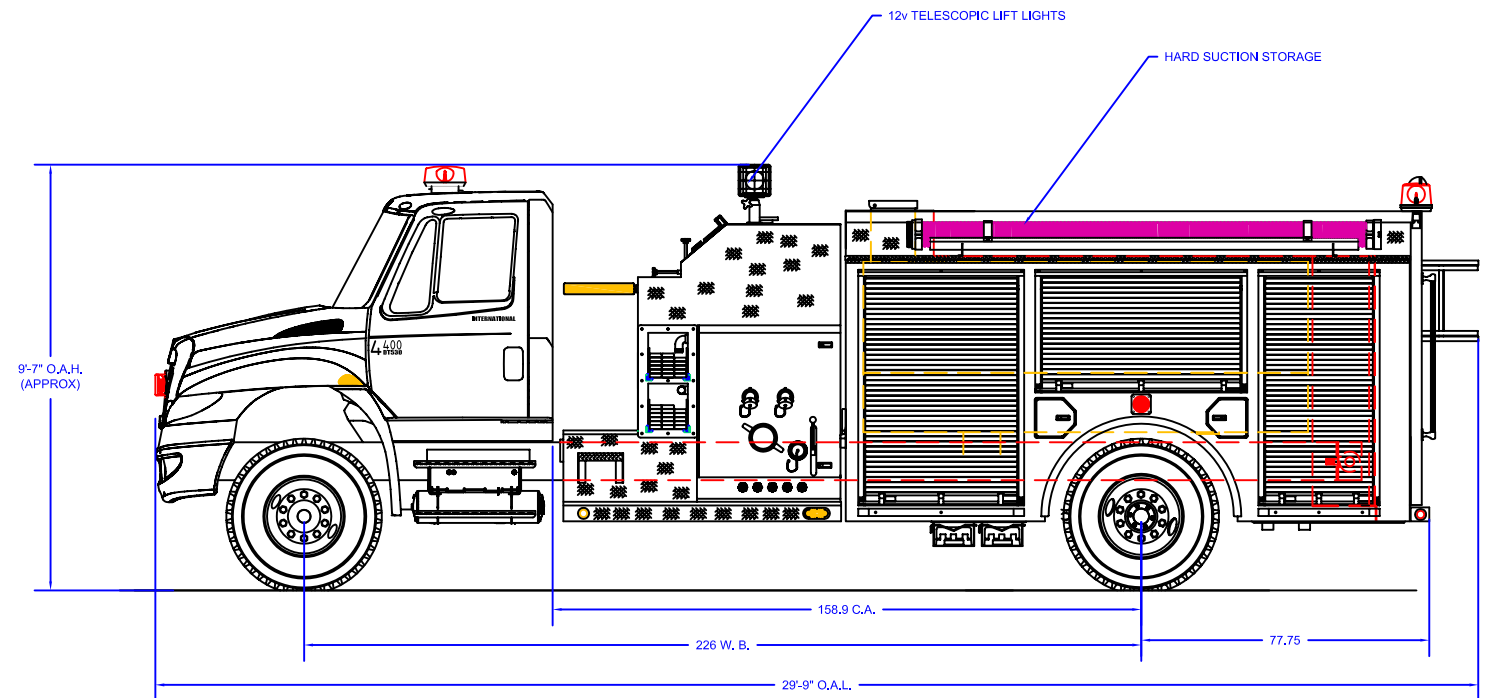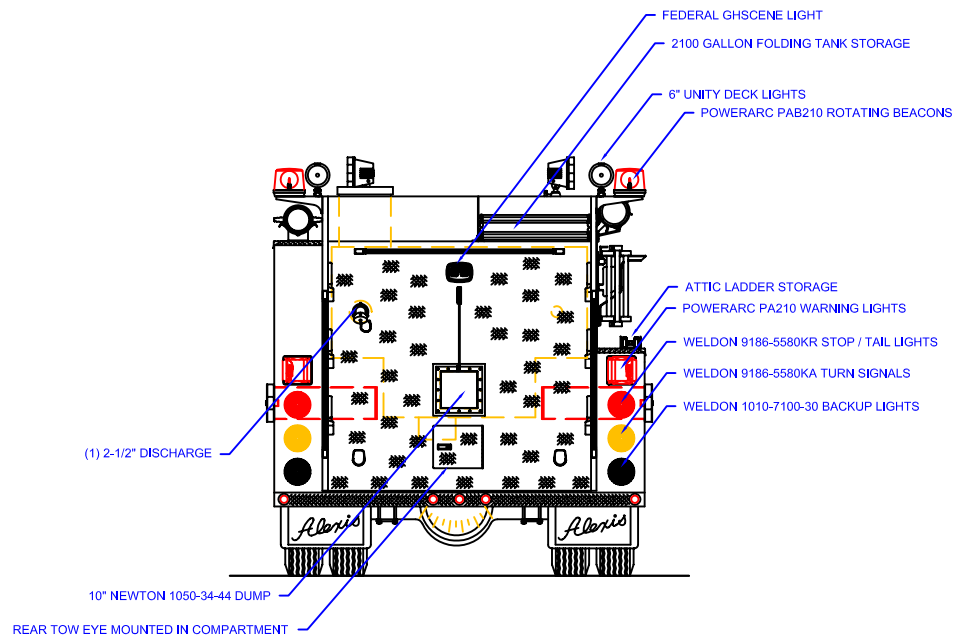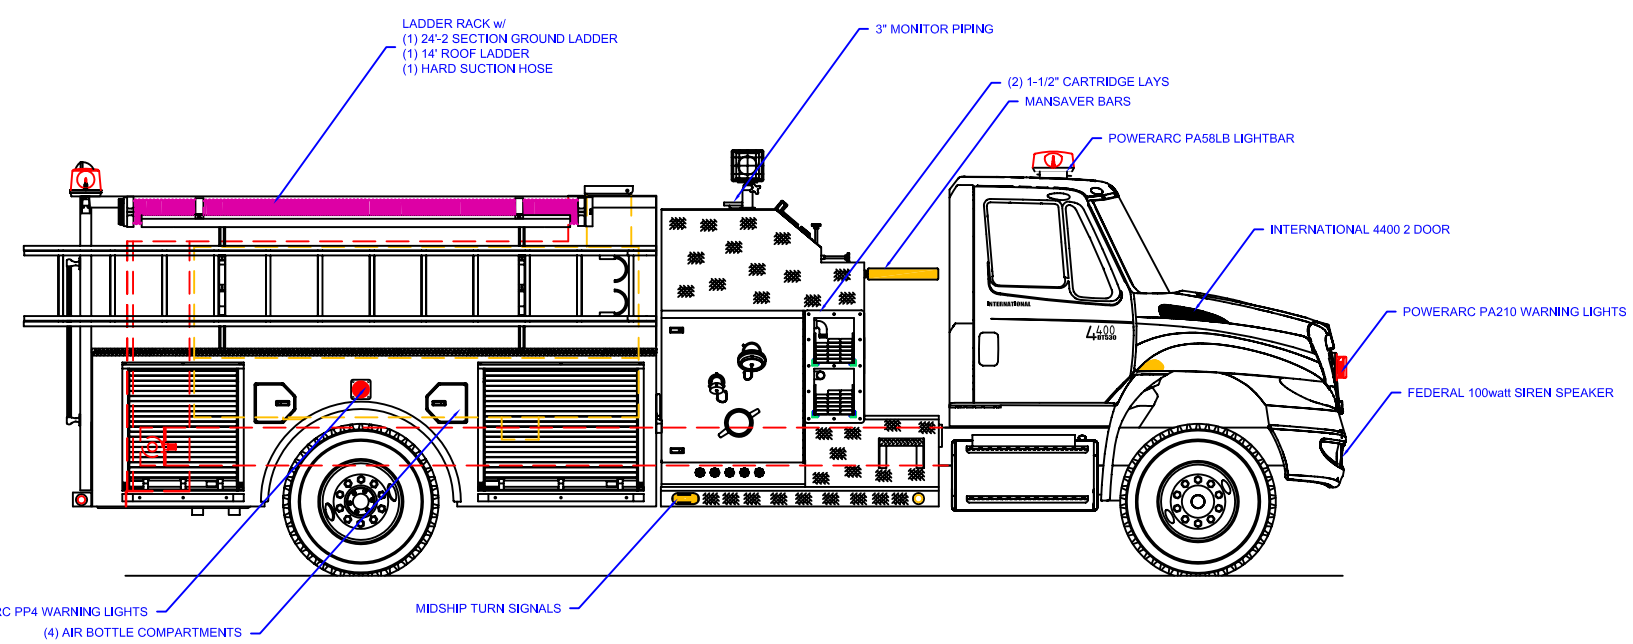

1000 GPM PUMP / 1250 GALLONS WATER
COMPARTMENT DIMENSIONS

COMP #	DOOR OPENING SIZES	COMPARTMENT INTERIOR DIMS
L1	41" WIDE X 58" HIGH	44" WIDE X 58" HIGH 24" DEEP
L2	53" WIDE X 27" HIGH	56" WIDE X 27" HIGH 12" DEEP
L3	29" WIDE X 58" HIGH	32" WIDE X 58" HIGH 24" DEEP
R1	41" WIDE X 29" HIGH	44" WIDE X 29" HIGH 24" DEEP
R2	29" WIDE X 29" HIGH	32" WIDE X 29" HIGH 24" DEEP

CUSTOMER APPROVAL SIGNATURE: _____ DATE: _____

UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN INCHES TOLERANCES ARE NOT CUMULATIVE

Alexis FIRE EQUIPMENT CO.
 P.O. BOX 549, ALEXIS, ILLINOIS 61412

TOP MOUNT PUMPER
SMITHFIELD FIRE PROT. DIST.
SMITHFIELD, IL

DECIMAL ± 0.062 ANGULAR ± 0.5°
 FRACTIONAL ± 1/16 METRIC ± 1.6 mm

DRAWN: JOSH MCELREA 12/23/03
 MATERIAL: _____

SIZE SCALE: D 1/2" = 1'
 DWG NO: P-K46
 CONTRACT #: 1874 SHEET 1 OF 1

REV	DESCRIPTION	DATE	DWN
1	CHANGE ORDER UPDATES	3/3/04	BRS
2	CHASSIS UPDATE	4/6/04	BRS

SMITHFLD-0001

IN THE EVENT THERE ARE DISCREPANCIES BETWEEN THE DRAWING AND THE SPECIFICATIONS, THE SPECIFICATIONS SHALL PREVAIL.

Y:\Trucks\Signed Units\Midships\P-K46.dwg, 9/24/2004 1:12:02 PM, bradley

8 7 6 5 4 3 2 1