

2000-GALLON WETSIDE TANKER



VILLAGE OF MORTON FIRE DEPARTMENT
MORTON, ILLINOIS



TECHNICAL SPECS





- Kenworth T370 2-Door Chassis
- Paccar PX-9, 330-HP Diesel Engine
- Allison 3000 EVS 6-speed Automatic Transmission
- Heavy Duty Stainless Steel Body
- ROM Roll UP Doors
- 2000-Gallon Wetside Poly Tank
- Two (2) 2 1/2" Fireman's Friend Tank Fills, rear
- One (1) Newton 10" square electric controlled swivel dump with 36" extension
- Darley HM, 500-GPM Pump
- Left side under tank pump operator's panel
- Two (2) 2 1/2" Discharges, left side
- One (1) 3" Discharge, right side
- Two (2) 1 1/2" Mattydale Preconnects, behind cab above pump module
- Two (2) Dual bottle Air bottle compartments, one (1) each side wheel well
- Two (2) Walk-away air pack brackets, right side compartment
- Turtle Tile on floors of compartments
- Two (2) Ziamatic hydraulic folding tank brackets for 2500-gallon tanks
- Suction Hose storage in the hosebed
- Progressive Dynamics on-board battery charger with Viair air compressor
- Kussmaul Super Auto Eject 120-volt shoreline connection
- Floor mounted console for emergency switches with map/binder storage, cab
- Whelen Electronic Siren with 100-watt Whelen speaker
- Audiovox Back-up Camera system with 7" color monitor
- Federal Q2B mechanical Siren, flush mounted front bumper
- Two (2) Air Horns, one (1) each side of hood
- Six (6) Whelen LED Scene lights, two (2) each side and two (2) rear
- Whelen LED Warning Light Package
- Chevron pattern striping, rear
- 9' 7" Overall height
- 26' 8" Overall length
- 210" Wheelbase
- 142" Cab to Axle
- 16,000 FAWR
- 30,000 RAWR
- 46,000 GVWR



ALEXIS

THANK YOU TO THE VILLAGE OF MORTON
FIRE DEPARTMENT FOR THE PURCHASE
OF THIS UNIT.

To view more photos and download flyer,
please visit us at AlexisFire.com

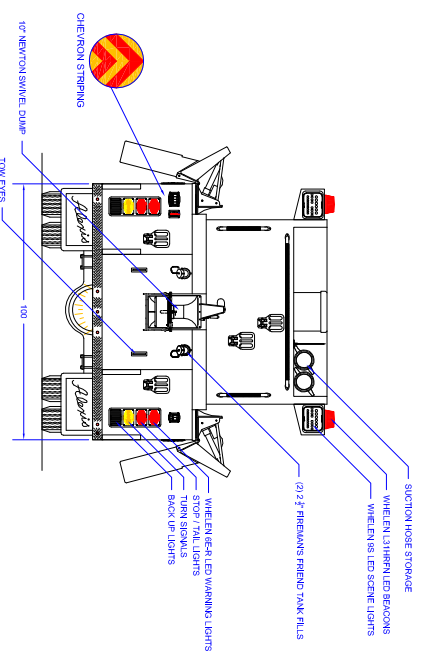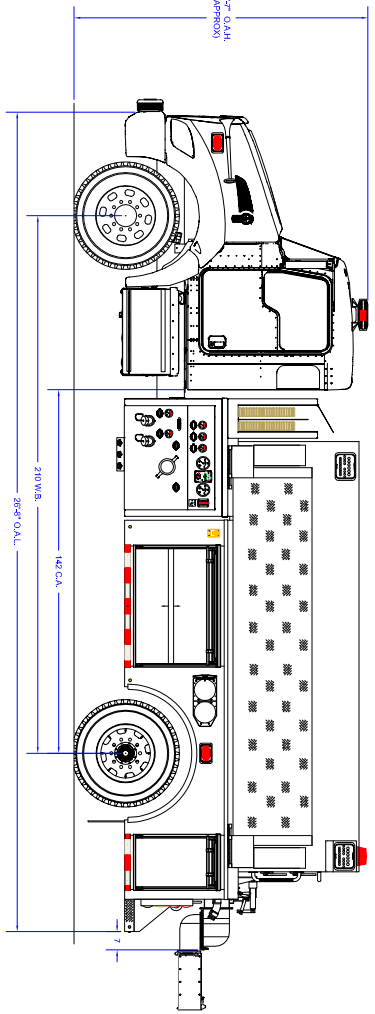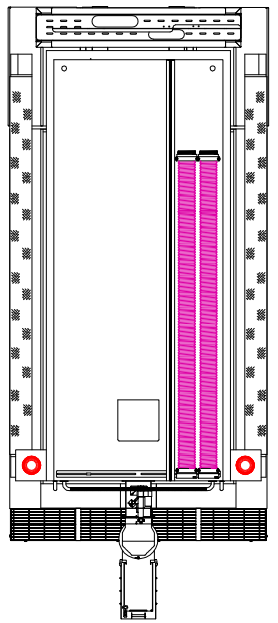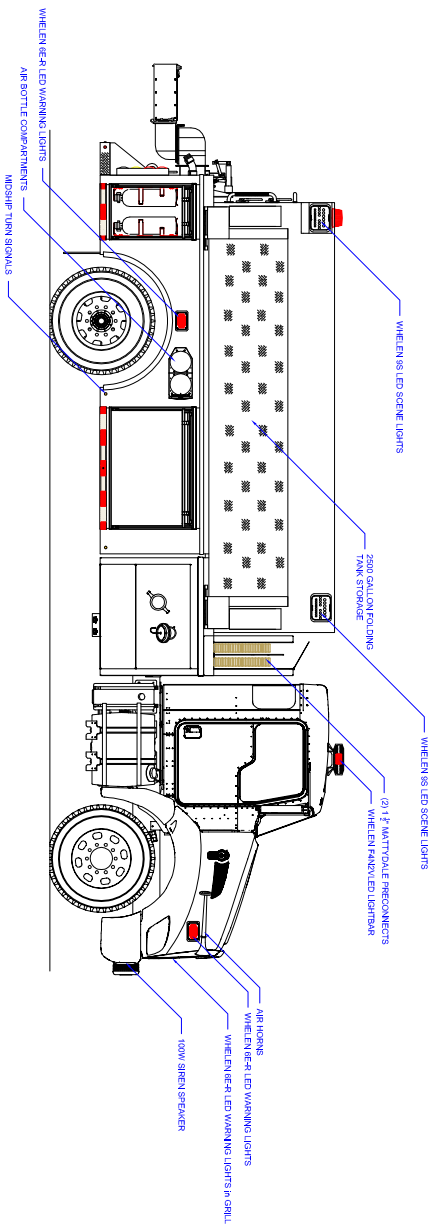

CUSTOMER APPROVAL SIGNATURE: _____ DATE: _____

MORTON-1002

IN THE EVENT THERE ARE DISCREPANCIES BETWEEN THE DRAWING AND THE SPECIFICATIONS, THE SPECIFICATIONS SHALL PREVAIL.

COMPARTMENT DIMENSIONS

COMP #	DOOR OPENING SIZES
LI & RT	46" WIDE X 27" HIGH X 26" DEEP
L2 & R2	19" WIDE X 27" HIGH X 26" DEEP

UNLESS OTHERWISE SPECIFIED
 DIMENSIONS ARE IN INCHES
 TOLERANCES ARE:
 ANGULAR ±.03°
 PERIODIC ±.015 INCHES ± 3.81 mm
 FINISH: MILL

WETSIDE TANKER
 P.O. BOX 549 ALEXIS, ILLINOIS 61412

MORTON FIRE DEPARTMENT
 MORTON, ILLINOIS

T-H69

SIZE: 3000 GPM
 CONTRACT # 2309

SHEET 1 OF 2

DATE: 12/18/15

BY: M. TINKHAM

DRAWN: 12/18/15

UNLESS OTHERWISE SPECIFIED

DIMENSIONS ARE IN INCHES

TOLERANCES ARE:

ANGULAR ±.03°

PERIODIC ±.015 INCHES ± 3.81 mm

FINISH: MILL

WETSIDE TANKER

P.O. BOX 549 ALEXIS, ILLINOIS 61412

MORTON FIRE DEPARTMENT

MORTON, ILLINOIS

T-H69

SIZE: 3000 GPM

CONTRACT # 2309

SHEET 1 OF 2

DATE: 12/18/15

BY: M. TINKHAM

DRAWN: 12/18/15

UNLESS OTHERWISE SPECIFIED

DIMENSIONS ARE IN INCHES

TOLERANCES ARE:

ANGULAR ±.03°

PERIODIC ±.015 INCHES ± 3.81 mm

FINISH: MILL

WETSIDE TANKER

P.O. BOX 549 ALEXIS, ILLINOIS 61412

MORTON FIRE DEPARTMENT

MORTON, ILLINOIS

T-H69

SIZE: 3000 GPM

CONTRACT # 2309

SHEET 1 OF 2

DATE: 12/18/15

BY: M. TINKHAM

DRAWN: 12/18/15

UNLESS OTHERWISE SPECIFIED

DIMENSIONS ARE IN INCHES

TOLERANCES ARE:

ANGULAR ±.03°

PERIODIC ±.015 INCHES ± 3.81 mm

FINISH: MILL

WETSIDE TANKER

P.O. BOX 549 ALEXIS, ILLINOIS 61412

MORTON FIRE DEPARTMENT

MORTON, ILLINOIS

T-H69

SIZE: 3000 GPM

CONTRACT # 2309

SHEET 1 OF 2

DATE: 12/18/15

BY: M. TINKHAM

DRAWN: 12/18/15

UNLESS OTHERWISE SPECIFIED

DIMENSIONS ARE IN INCHES

TOLERANCES ARE:

ANGULAR ±.03°

PERIODIC ±.015 INCHES ± 3.81 mm

FINISH: MILL

WETSIDE TANKER

P.O. BOX 549 ALEXIS, ILLINOIS 61412

MORTON FIRE DEPARTMENT

MORTON, ILLINOIS

T-H69

SIZE: 3000 GPM

CONTRACT # 2309

SHEET 1 OF 2

DATE: 12/18/15

BY: M. TINKHAM

DRAWN: 12/18/15

UNLESS OTHERWISE SPECIFIED

DIMENSIONS ARE IN INCHES

TOLERANCES ARE:

ANGULAR ±.03°

PERIODIC ±.015 INCHES ± 3.81 mm

FINISH: MILL

WETSIDE TANKER

P.O. BOX 549 ALEXIS, ILLINOIS 61412

MORTON FIRE DEPARTMENT

MORTON, ILLINOIS

T-H69

SIZE: 3000 GPM

CONTRACT # 2309

SHEET 1 OF 2

DATE: 12/18/15

BY: M. TINKHAM

DRAWN: 12/18/15

UNLESS OTHERWISE SPECIFIED

DIMENSIONS ARE IN INCHES

TOLERANCES ARE:

ANGULAR ±.03°

PERIODIC ±.015 INCHES ± 3.81 mm

FINISH: MILL

WETSIDE TANKER

P.O. BOX 549 ALEXIS, ILLINOIS 61412

MORTON FIRE DEPARTMENT

MORTON, ILLINOIS

T-H69

SIZE: 3000 GPM

CONTRACT # 2309

SHEET 1 OF 2

DATE: 12/18/15

BY: M. TINKHAM

DRAWN: 12/18/15

UNLESS OTHERWISE SPECIFIED

DIMENSIONS ARE IN INCHES

TOLERANCES ARE:

ANGULAR ±.03°

PERIODIC ±.015 INCHES ± 3.81 mm

FINISH: MILL

WETSIDE TANKER

P.O. BOX 549 ALEXIS, ILLINOIS 61412

MORTON FIRE DEPARTMENT

MORTON, ILLINOIS

T-H69

SIZE: 3000 GPM

CONTRACT # 2309

SHEET 1 OF 2

DATE: 12/18/15

BY: M. TINKHAM

DRAWN: 12/18/15

UNLESS OTHERWISE SPECIFIED

DIMENSIONS ARE IN INCHES

TOLERANCES ARE:

ANGULAR ±.03°

PERIODIC ±.015 INCHES ± 3.81 mm

FINISH: MILL

WETSIDE TANKER

P.O. BOX 549 ALEXIS, ILLINOIS 61412

MORTON FIRE DEPARTMENT

MORTON, ILLINOIS

T-H69

SIZE: 3000 GPM

CONTRACT # 2309

SHEET 1 OF 2

DATE: 12/18/15

BY: M. TINKHAM

DRAWN: 12/18/15

UNLESS OTHERWISE SPECIFIED

DIMENSIONS ARE IN INCHES

TOLERANCES ARE:

ANGULAR ±.03°

PERIODIC ±.015 INCHES ± 3.81 mm

FINISH: MILL

WETSIDE TANKER

P.O. BOX 549 ALEXIS, ILLINOIS 61412

MORTON FIRE DEPARTMENT

MORTON, ILLINOIS

T-H69

SIZE: 3000 GPM

CONTRACT # 2309

SHEET 1 OF 2

DATE: 12/18/15

BY: M. TINKHAM

DRAWN: 12/18/15

UNLESS OTHERWISE SPECIFIED

DIMENSIONS ARE IN INCHES

TOLERANCES ARE:

ANGULAR ±.03°

PERIODIC ±.015 INCHES ± 3.81 mm

FINISH: MILL

WETSIDE TANKER

P.O. BOX 549 ALEXIS, ILLINOIS 61412

MORTON FIRE DEPARTMENT

MORTON, ILLINOIS

T-H69

SIZE: 3000 GPM

CONTRACT # 2309

SHEET 1 OF 2

DATE: 12/18/15

BY: M. TINKHAM

DRAWN: 12/18/15

UNLESS OTHERWISE SPECIFIED

DIMENSIONS ARE IN INCHES

TOLERANCES ARE:

ANGULAR ±.03°

PERIODIC ±.015 INCHES ± 3.81 mm

FINISH: MILL

WETSIDE TANKER

P.O. BOX 549 ALEXIS, ILLINOIS 61412

MORTON FIRE DEPARTMENT

MORTON, ILLINOIS

T-H69

SIZE: 3000 GPM

CONTRACT # 2309

SHEET 1 OF 2

DATE: 12/18/15

BY: M. TINKHAM

DRAWN: 12/18/15

UNLESS OTHERWISE SPECIFIED

DIMENSIONS ARE IN INCHES

TOLERANCES ARE:

ANGULAR ±.03°

PERIODIC ±.015 INCHES ± 3.81 mm

FINISH: MILL

WETSIDE TANKER

P.O. BOX 549 ALEXIS, ILLINOIS 61412

MORTON FIRE DEPARTMENT

MORTON, ILLINOIS

T-H69

SIZE: 3000 GPM

CONTRACT # 2309

SHEET 1 OF 2

DATE: 12/18/15

BY: M. TINKHAM

DRAWN: 12/18/15

UNLESS OTHERWISE SPECIFIED

DIMENSIONS ARE IN INCHES

TOLERANCES ARE:

ANGULAR ±.03°

PERIODIC ±.015 INCHES ± 3.81 mm

FINISH: MILL

WETSIDE TANKER

P.O. BOX 549 ALEXIS, ILLINOIS 61412

MORTON FIRE DEPARTMENT

MORTON, ILLINOIS

T-H69

SIZE: 3000 GPM

CONTRACT # 2309

SHEET 1 OF 2

DATE: 12/18/15

BY: M. TINKHAM

DRAWN: 12/18/15

UNLESS OTHERWISE SPECIFIED

DIMENSIONS ARE IN INCHES

TOLERANCES ARE:

ANGULAR ±.03°

PERIODIC ±.015 INCHES ± 3.81 mm

FINISH: MILL

WETSIDE TANKER

P.O. BOX 549 ALEXIS, ILLINOIS 61412

MORTON FIRE DEPARTMENT

MORTON, ILLINOIS

T-H69

SIZE: 3000 GPM

CONTRACT # 2309

SHEET 1 OF 2

DATE: 12/18/15

BY: M. TINKHAM

DRAWN: 12/18/15

UNLESS OTHERWISE SPECIFIED

DIMENSIONS ARE IN INCHES

TOLERANCES ARE:

ANGULAR ±.03°

PERIODIC ±.015 INCHES ± 3.81 mm

FINISH: MILL

WETSIDE TANKER

P.O. BOX 549 ALEXIS, ILLINOIS 61412

MORTON FIRE DEPARTMENT